



REV.	BY	DATE	APPROVED

CUSTOMER CONNECTIONS PER FIGURES AT LEFT



SINGLE POLE



TWO POLE



THREE POLE

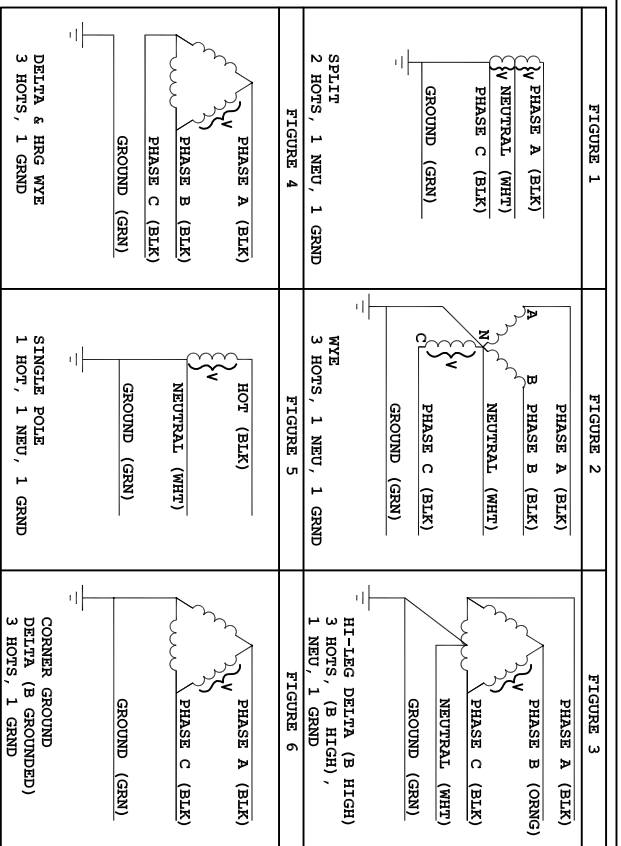

MODEL	SERVICE VOLTAGE	FIGURE
S50A120V1P	120V Single Phase	5
S50A120V2P	240/120V 1Ø, 3W Plus Ground	1
S50A120V3X	208Y/120V 3Ø, 4W Plus Ground	2
S50A127V1P	127V Single Phase	5
S50A127V2E	254/127V 1Ø, 3W Plus Ground	1
S50A127V3X	220Y/127V 3Ø, 4W Plus Ground	2
S50A220V1P	220V Single Phase	5
S50A220V3X	380Y/220V 3Ø, 4W Plus Ground	2
S50A240V3H	240/120V 3Ø, 4W Plus Ground High Leg Delta	3
S50A240V1P	240V Single Phase	5
S50A240V3P	240V 3Ø, 3W Plus Ground	4
S50A277V1P	277V Single Phase	5
S50A277V2E	480/240V 1Ø, 3W Plus Ground	1
S50A277V3X	480Y/277V 3Ø, 4W Plus Ground	2
S50A347V3X	600Y/347V 3Ø, 4W Plus Ground	2
S50A480V1P	480V Single Phase	5
S50A480V3D	480V 3Ø, 3W Plus Ground	4
S50A480V3H	480/240V 3Ø, 4W Plus Ground High Leg Delta	3
S50A600V3D	600V 3Ø, 3W Plus Ground	4
S100A120V2P	240/120V 1Ø, 3W Plus Ground	1
S100A277V2P	480/240V 1Ø, 3W Plus Ground	1

MATERIAL:		FINISH:	
SPECIFICATION:		SPECIFICATION:	
ADVANCED PROTECTION EQUIPMENT S50A/S100A	SPDee SERIES H. BROCKERS 4/17/98 J.L.S. 4/17/98 H.A.S. 4/17/98	ADVANCED PROTECTION EQUIPMENT S50A/S100A	SPDee SERIES ELECTRICAL S50A/S100A
DATE: 4/17/98 BY: J.L.S. CHECKED: H.A.S. APPROVED: H.A.S.	DATE: 4/17/98 BY: J.L.S. CHECKED: H.A.S. APPROVED: H.A.S.	DATE: 4/17/98 BY: J.L.S. CHECKED: H.A.S. APPROVED: H.A.S.	DATE: 4/17/98 BY: J.L.S. CHECKED: H.A.S. APPROVED: H.A.S.

ELECTRONIC COPY IS UNCONTROLLED WHEN PRINTED. ALWAYS VIEW LATEST REVISION IN USE.